


# LEVEL III: WHEN WE SAY FULLY REBUILT, WE MEAN IT.

- Complete inspection, disassembly, reassembly and final testing is performed in one of several RESA Power breaker facilities nationwide.
- All parts are cleaned, abrasive blasted, re-coated, re-plated, and reassembled for testing by our skilled technicians.

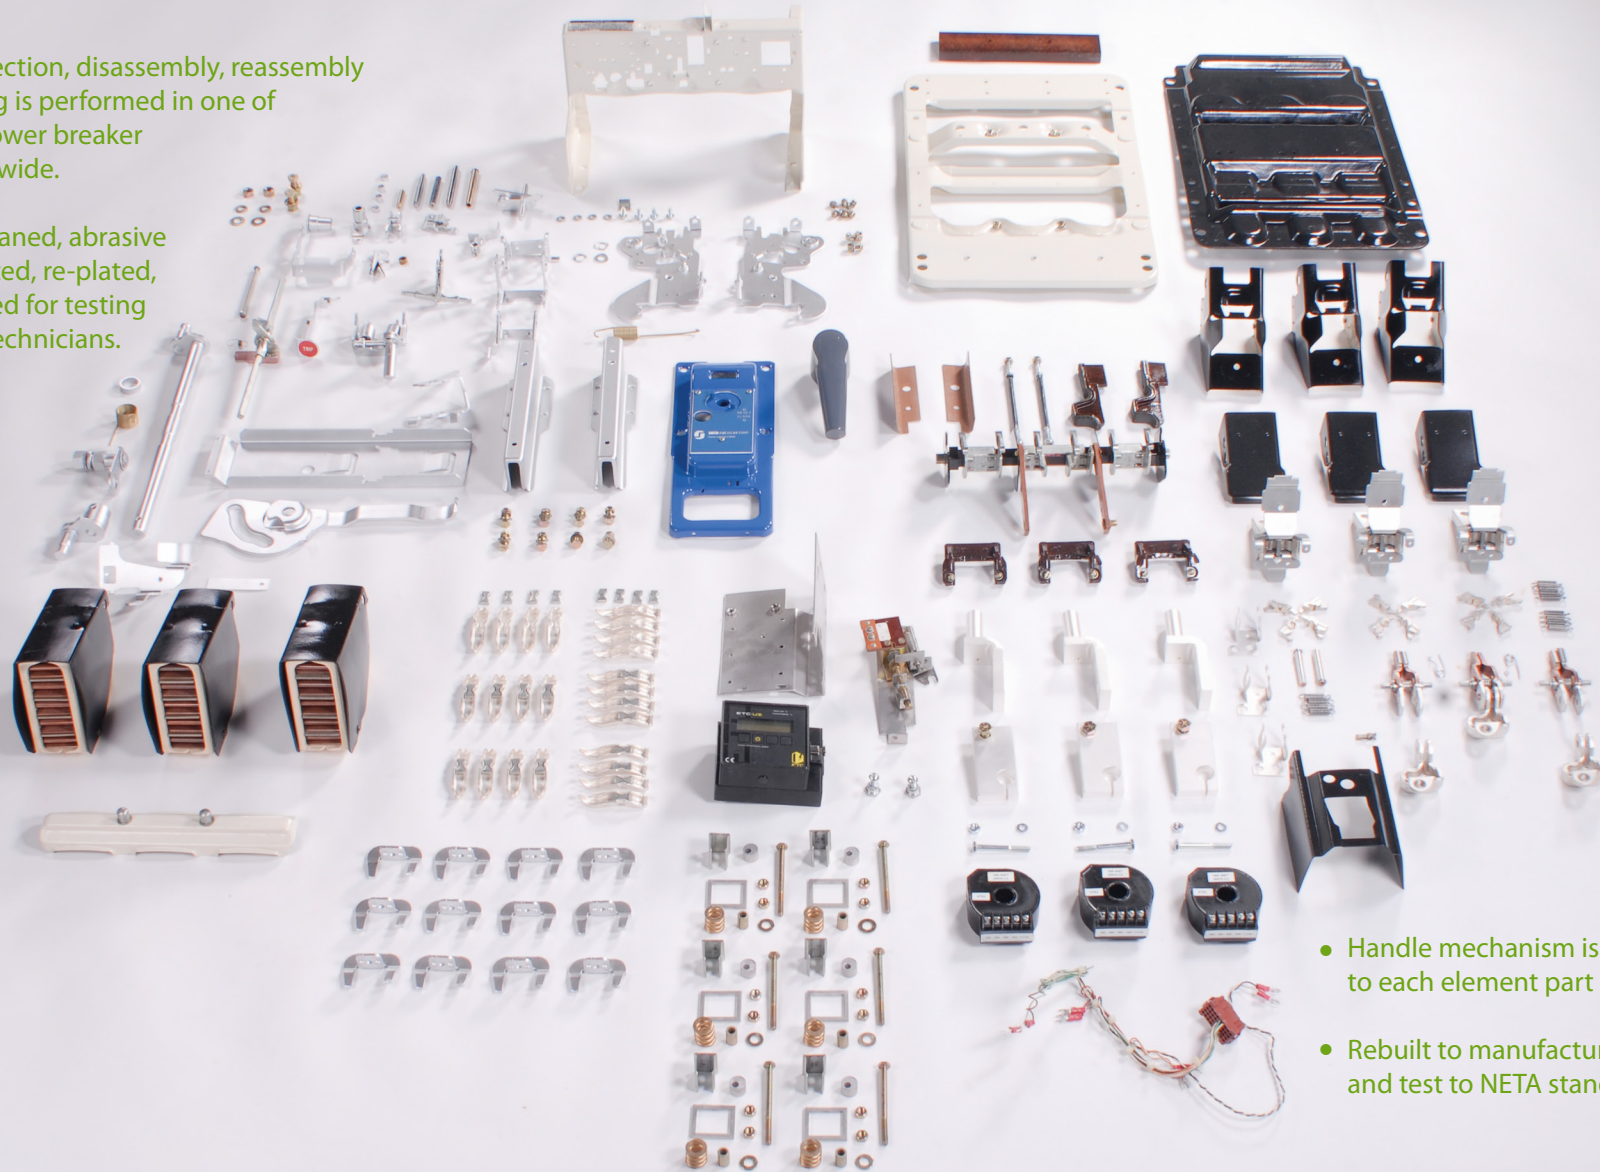

- Handle mechanism is disassembled to each element part and inspected.
- Rebuilt to manufacturers specifications and test to NETA standards

Life Extension For Power Systems

ENGINEERED PRODUCTS: Level 3 Remanufacture - GE AK-2-25-2 Low Voltage Power Circuit Breaker Disassembled. ♻️

[WWW.RESAPOWER.COM](http://WWW.RESAPOWER.COM) | 1.844.583.RESA

